


NEW +33°F FRESH FISH COOLER


N.T.S.
NOTE: AIR UNIT POWER WIRING BY EC.
NOTE: AIR UNIT CONTROL VALVE WIRING (120V) BY RC.

SHOWN
ZONE 11 ZONE 12 ZONE 13 ZONE 14

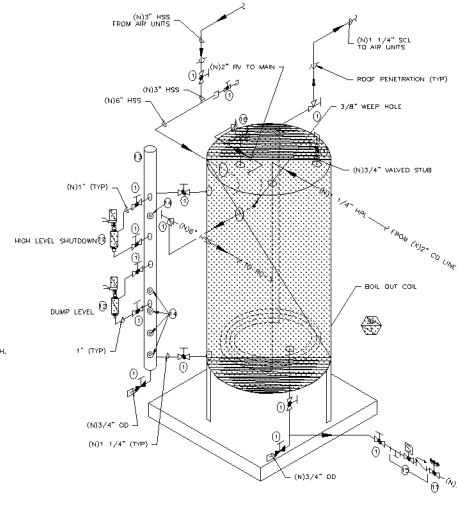

SUCTION ACCUMULATOR PIPING ISOMETRIC


N.T.S.

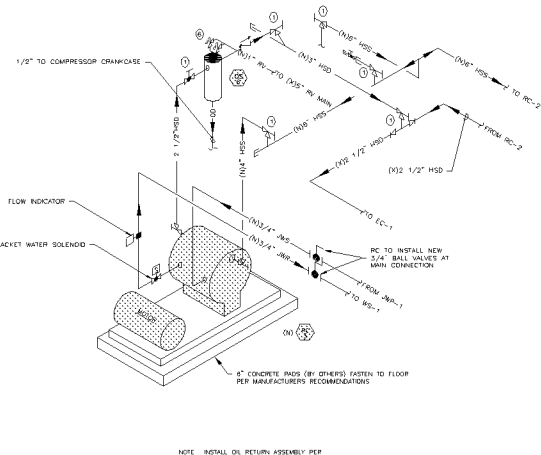

RECIPROCATING COMPRESSOR PIPING ISOMETRIC

N.T.S.


NEW
SHOWN

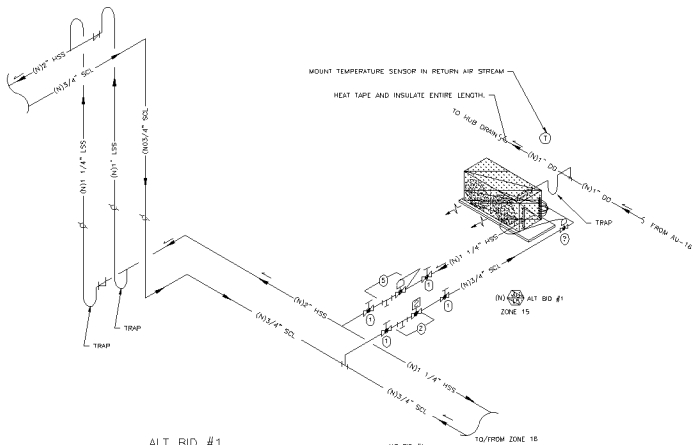

**ALT BID #1
NEW +36°F TRUCK DOCK**

N.T.S.
NOTE: AIR UNIT POWER WIRING BY EC.
NOTE: AIR UNIT CONTROL VALVE WIRING (120V) BY RC.


SHOWN
ZONE 13 ZONE 14

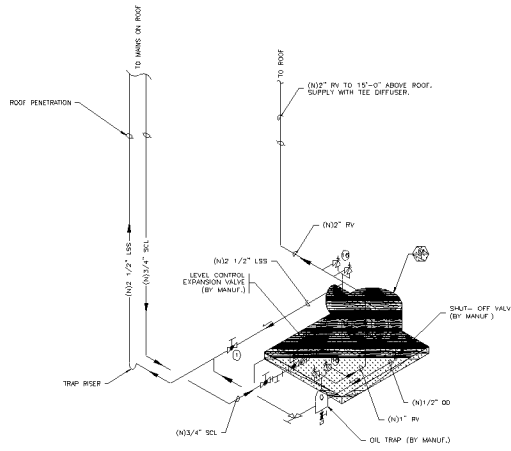

**ALT BID #2
ICE MAKER PIPING ISOMETRIC**

N.T.S.

ALT BID #1 ALT BID #1 ALT BID #1
SHOWN SHOWN SHOWN
NEW NEW NEW

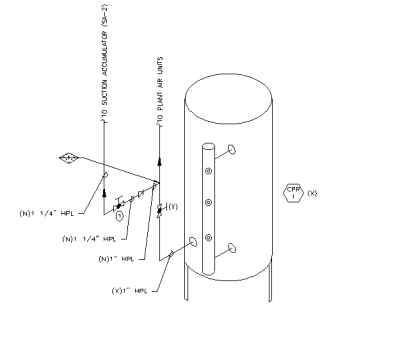

**EXISTING CONTROL PRESSURE RECEIVER
PIPING ISOMETRIC**

N.T.S.

KEY NOTE

CONNECT NEW 1 1/4\"/>

Stahlman
Engineering Corp.
1000 NEW HAVEN AVENUE
NEW HAVEN, CT 06511
PHONE: (860) 262-2885 FAX: (860) 262-9488

NO.	DATE	BY	REVISION



CLIENT	STAMPS SEAFOODS, INC.
PROJECT	2008 FACILITY EXPANSION PROGRAM
DRAWING	MISCELLANEOUS PIPING ISOMETRICS
DATE	08/08/03
SCALE	N.T.S.
DRAWN BY	ECG
DRAWING NO.	

R21
COOLER
© 2003 STAHLMAN
ENGINEERING CORP.